


Particle Size Distribution Study

Account Name - Site Name
Cooling Tower
Sampled - 11/1/2007

Particle Count

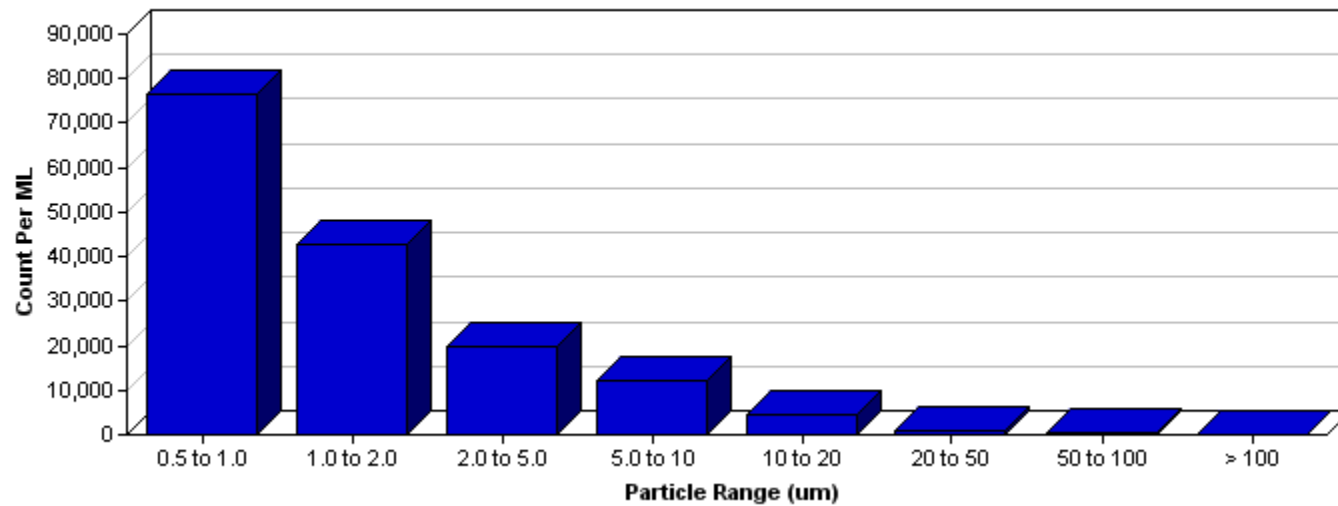

Particle Size	0.5 to 1.0	1.0 to 2.0	2.0 to 5.0	5.0 to 10	10 to 20	20 to 50	50 to 100	> 100
Count/ml	76,584	42,852	19,746	12,095	4,388	836	472	0