



Particle Count Comparison

Account Name - Site Name

Cooling Tower - Sampled 5/3/2010

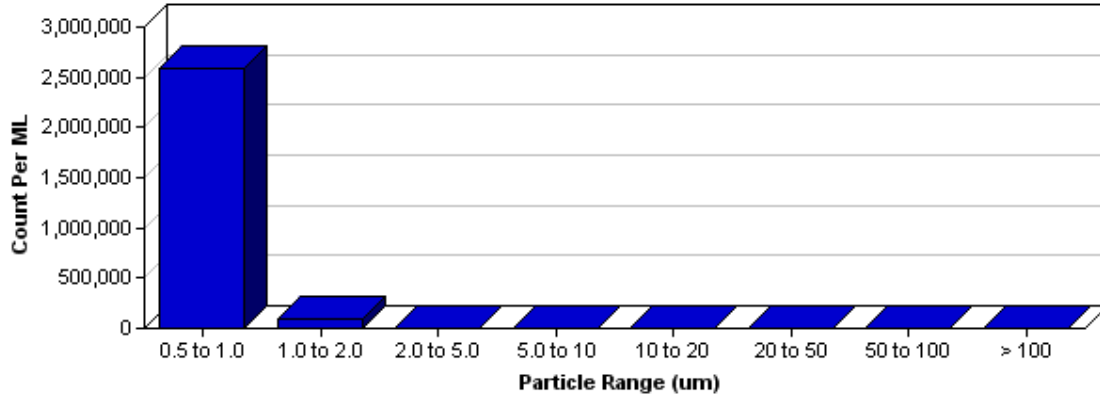

Cooling Tower After Filter - Sampled 5/3/2010

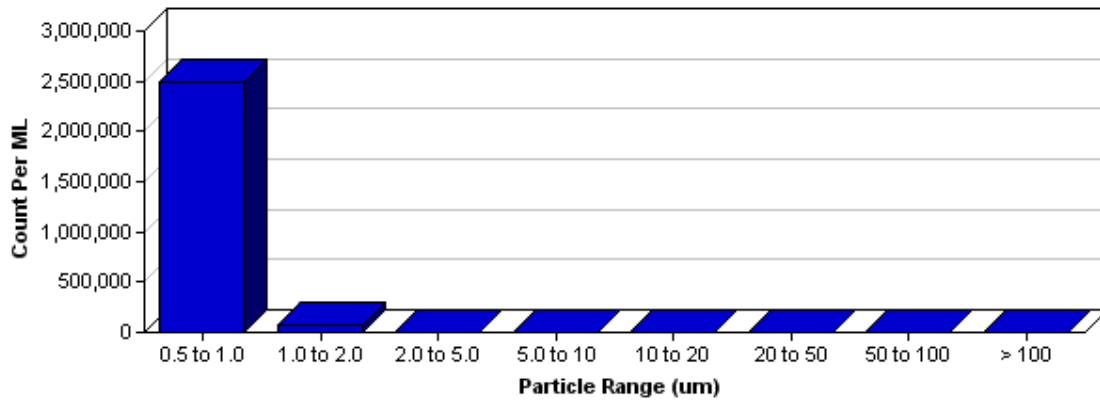

Particle Size	0.5 to 1.0	1.0 to 2.0	2.0 to 5.0	5.0 to 10	10 to 20	20 to 50	50 to 100	> 100
Cooling Tower	2,595,123	97,543	3,482	650	271	180	108	0
Cooling Tower After Filter	2,489,442	84,010	1,534	379	72	54	18	0
Δ	105,681	13,533	1,948	271	199	126	90	0
%Δ	4%	14%	56%	42%	73%	70%	83%	0%